

## Information

### Notes

Non-return valves are required on Systemlink's outward zone flow pipe-work only when the zone to be piped is at a higher level than the Systemlink. In that situation, a non-return valve must be positioned in front of the zone pump. This will prevent the creation of a gravity fed, thermo-siphoning loop, which would cause continued supply of heated water to the radiators in that zone, even when the zone's pump is no longer required and has been switched off.


This schematic shows the key components in the mechanical system and the list of materials shown is non-exhaustive. All systems should be installed in accordance with building regulations and by a qualified installer.

The schematic is a representation of a heating system and Systemlink will not be held responsible for any errors shown.

**systemlink**  
ENERGY SAVING SOLUTIONS

### Systemlink

Unit 1 Greenhills Business Park,  
Tallaght, Dublin 24  
Tel: 00-353-(0)1 4031200  
Fax: 00-353-(0)1 4137777  
e-mail: [info@systemlink.ie](mailto:info@systemlink.ie)  
e-mail: [info@systemlink.co.uk](mailto:info@systemlink.co.uk)

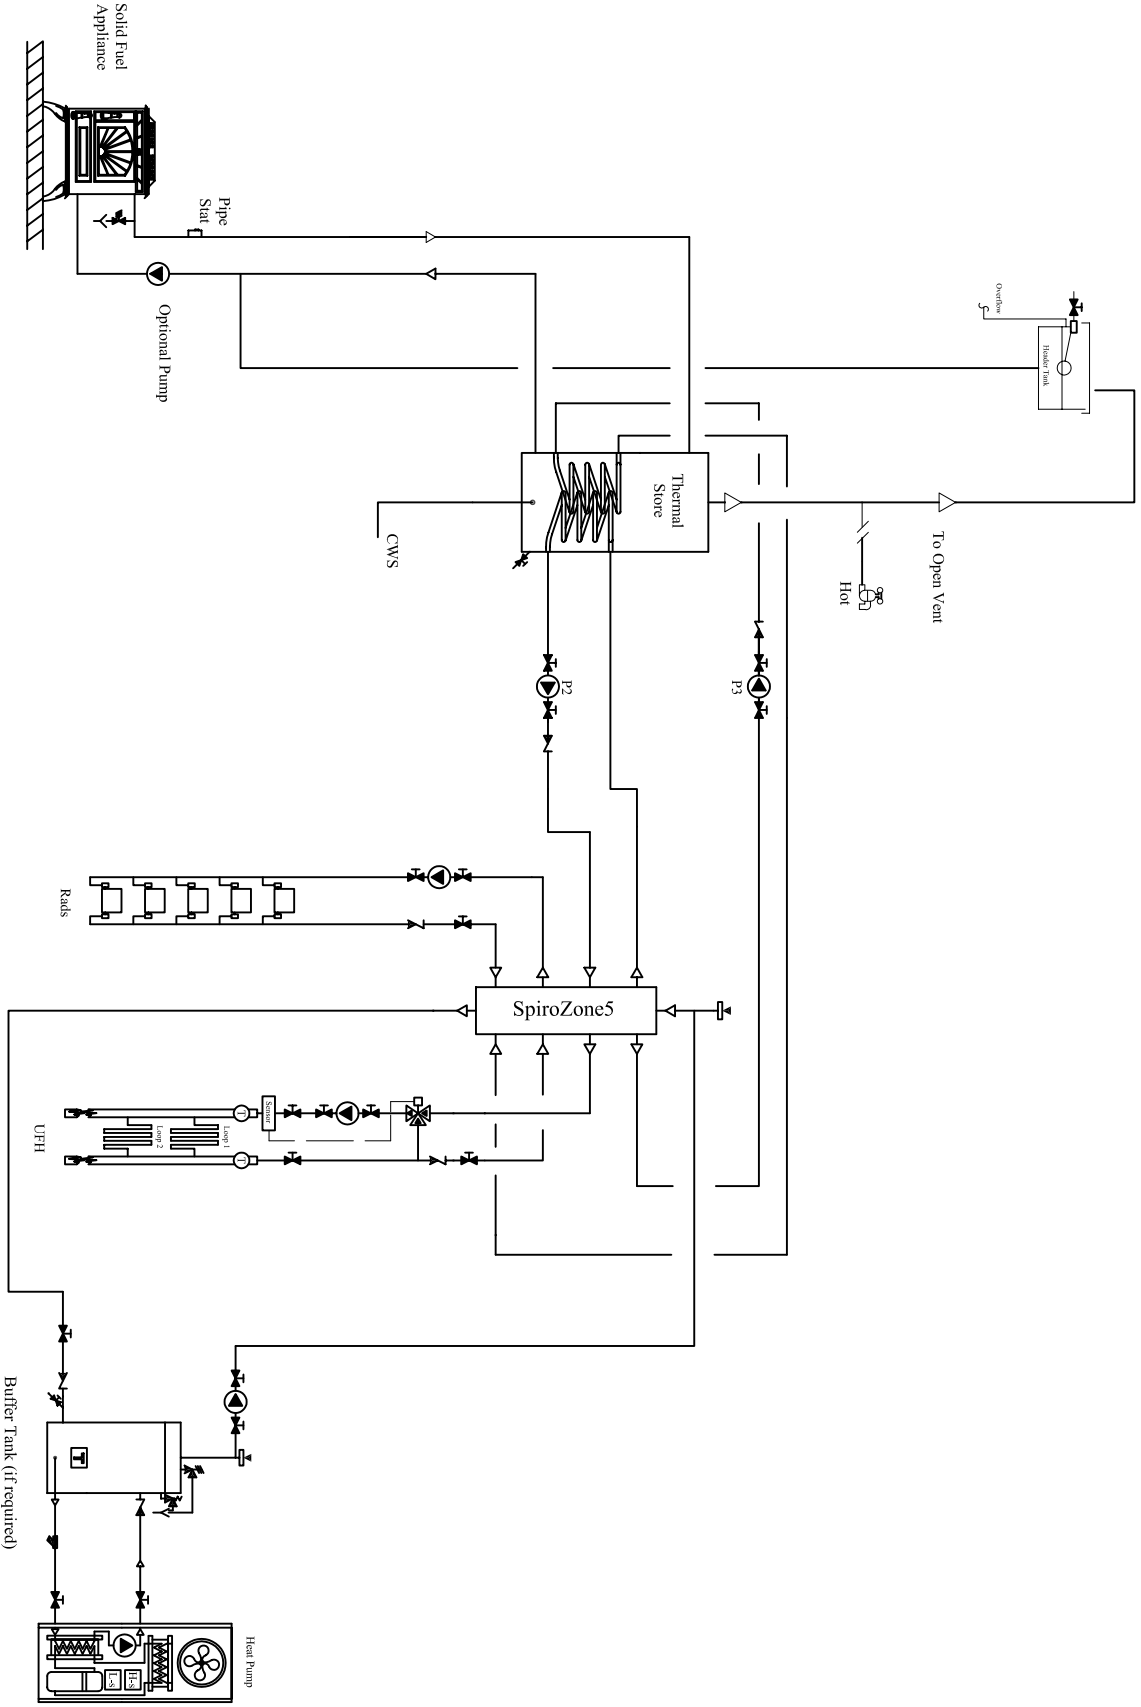

### LEGEND

	Motorised Valve		Oil Fire Slam Valve		Motorised Valve
	Isolating Valve		Temperature Relief Valve		Automatic Air Valve
	Safety Valve		Pressure Regulating Valve		Pressure Gauge
	Non Return Valve		Flow Regulating Valve		Temperature Gauge
	Pressure Relief Valve		Pressure Reducing Valve		Temperature Sensor
	Temnobac		Strainer		DW Pressurisation Pump
	Gas Slam Valve		Binder Test Point		Direction Arrow
	Hi-Pressure Switch		Low Pressure Switch		Circulating Pump

Example: Heating Schematic  
Open Vented Solid Fuel Stove

Scale: NTS

Rev: 002

Drawing No.

Date: 09-07-2015