


Information

Notes

Sprolzone has a valve controlled by-pass for greater efficiency. This ensures complete separation of the hot flow and colder return water within the manifold. Please of this, a standard spring loaded Non-return valve is required on each circuit connected to a Sprolzone.

This schematic shows the key components in the mechanical system and the list of materials shown is non-exhaustive. All systems should be installed in accordance with building regulations and by a qualified installer.

The schematic is a representation of a heating system and Systemlink will not be held responsible for any errors shown.

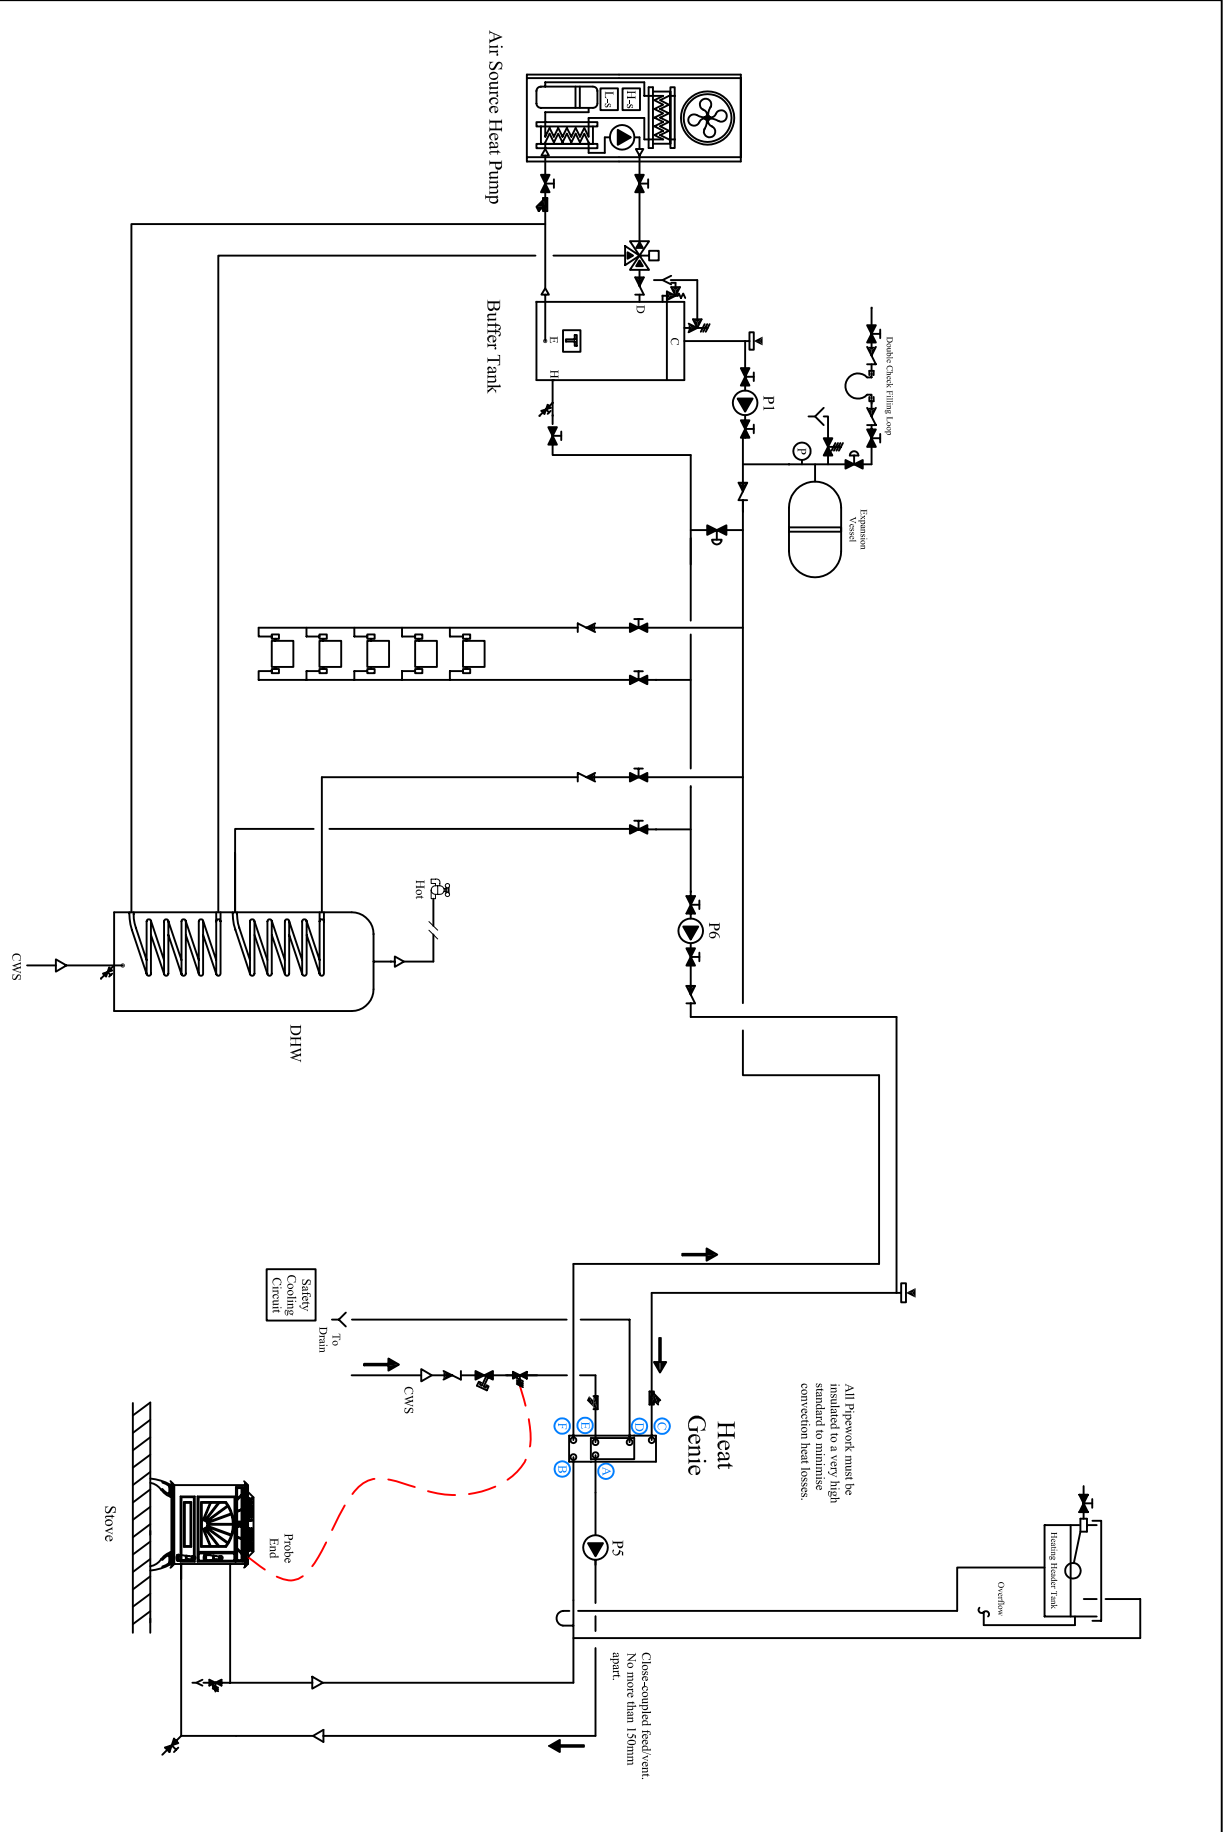

LEGEND

- |  |                          |  |                        |
|--|--------------------------|--|------------------------|
|  | Motorised Valve          |  | Motorised Valve        |
|  | Isolating Valve          |  | Automatic Air Valve    |
|  | Safety Valve             |  | Pressure Gauge         |
|  | Non Return Valve         |  | Temperature Sensor     |
|  | Temperature Relief Valve |  | Direction Arrow        |
|  | By-Pass Valve            |  | Strainer               |
|  | Flow Regulating Valve    |  | DW Pressurisation Pump |
|  | Pressure Reducing Valve  |  | Drain Cock             |
|  | Temperature Sensor       |  | Circulating Pump       |

Example: Heating Schematic  
Ref:

Systemlink  
C2 South City Business Centre,  
Tallaght, Dublin 24

Tel: 00-353-(0)1 4031200  
Fax: 00-353-(0)1 4137777  
email: info@systemlink.ie  
email: info@systemlink.co.uk

Scale: NTS

Rev: 001

Drawn: MC

20.06.14