


## Information

## Notes


SpiroZone has a valve controlled by pass for greater efficiency. This ensures complete separation of the hot flow and cooler return water within the manifold. Because of this, a standard spring loaded Non-return valve is required on each circuit connected to a SpiroZone.

This schematic shows the key components in the mechanized system and the list of materials shown is non-exhaustive. All systems should be installed in accordance with building regulations and by a qualified installer.

The schematic is a representation of a heating system and Systemlink will not be held responsible for any errors shown.

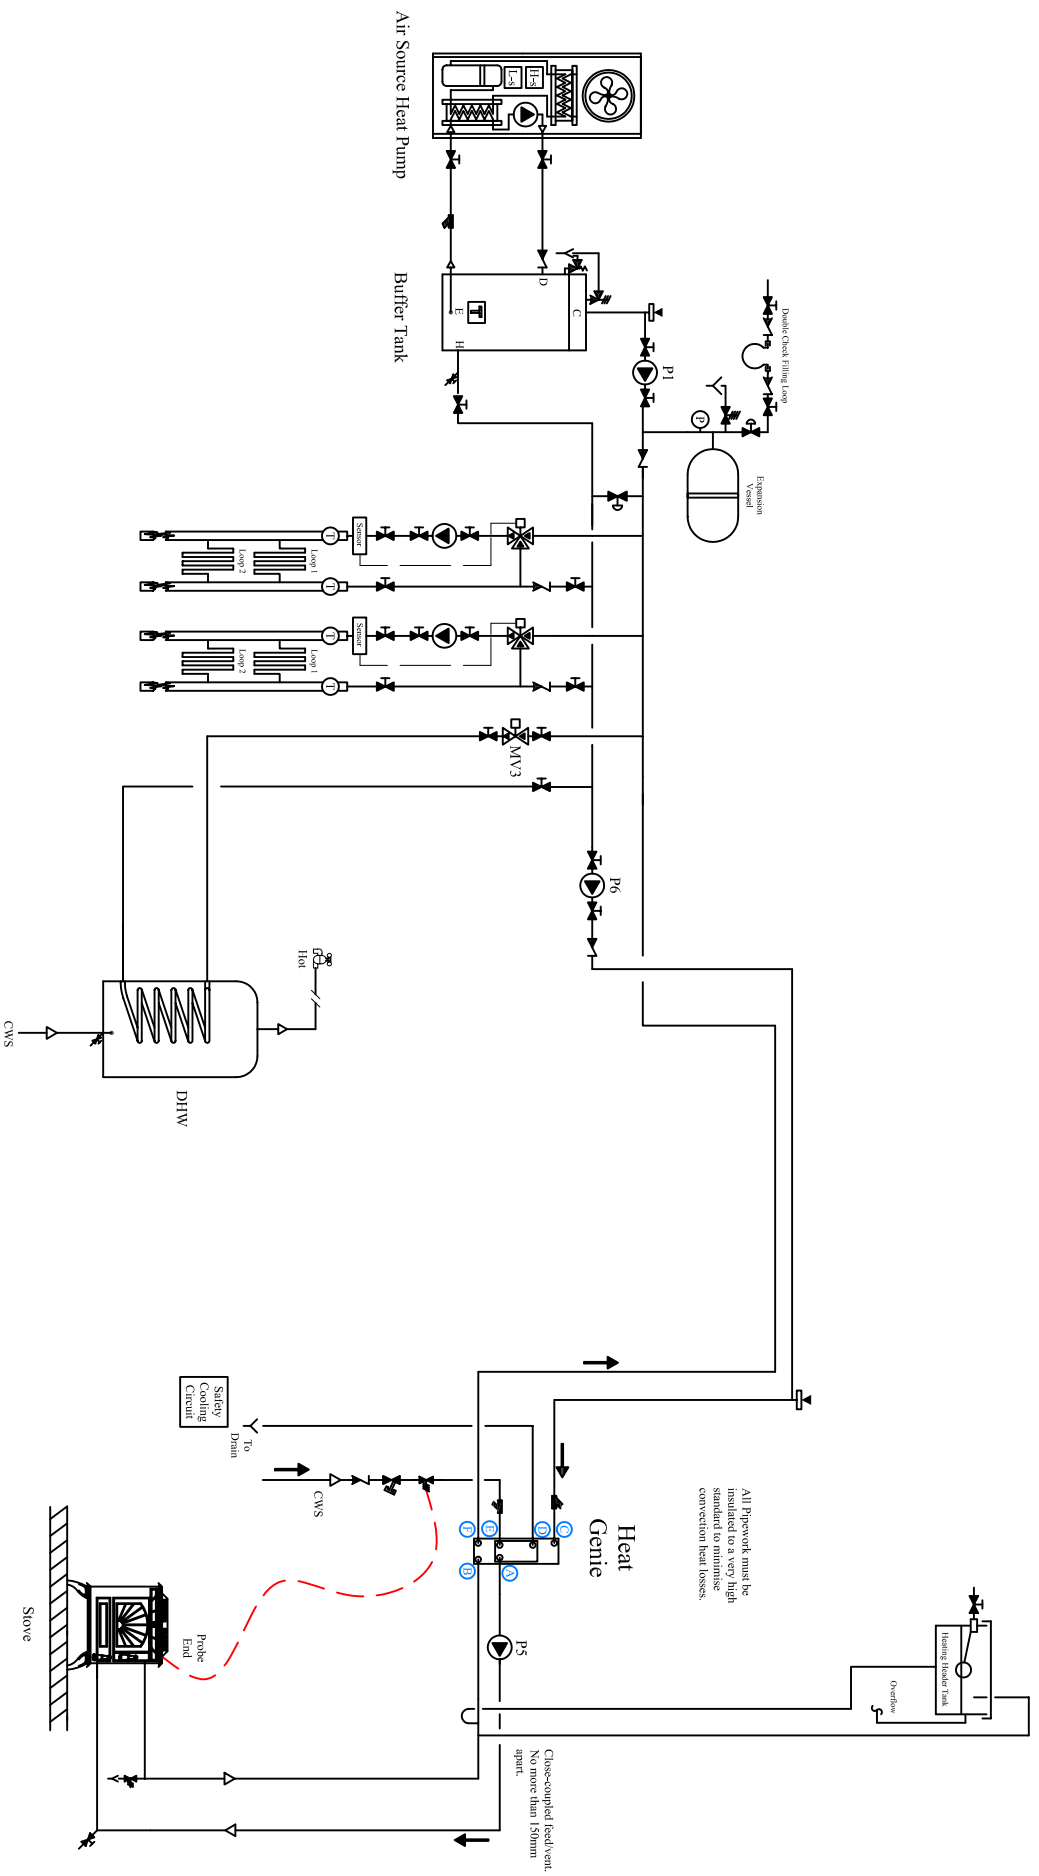

## LEGEND



Example: Heating Schematic  
Ref: David McConnell

**SystemLink**  
C2 South City Business Centre,  
Tallaght, Dublin 24  
Tel: 00-353-(0)1 4031200  
Fax: 00-353-(0)1 4137777  
e-mail, info@systemlink.ie  
e-mail, info@systemlink.co.uk

Scale: NTS

Rev: 001

---

Drawn: CC

23.05.14