


Isolated
Power Supply

SystemLex Control Wiring.

'Live' & 'Neutral' Tracks already exist on the SystemLex and need not be installed

'Lex-Links' already exist on the SystemLex and need not be installed

'Installer-Links' MUST be fitted by the installing engineer

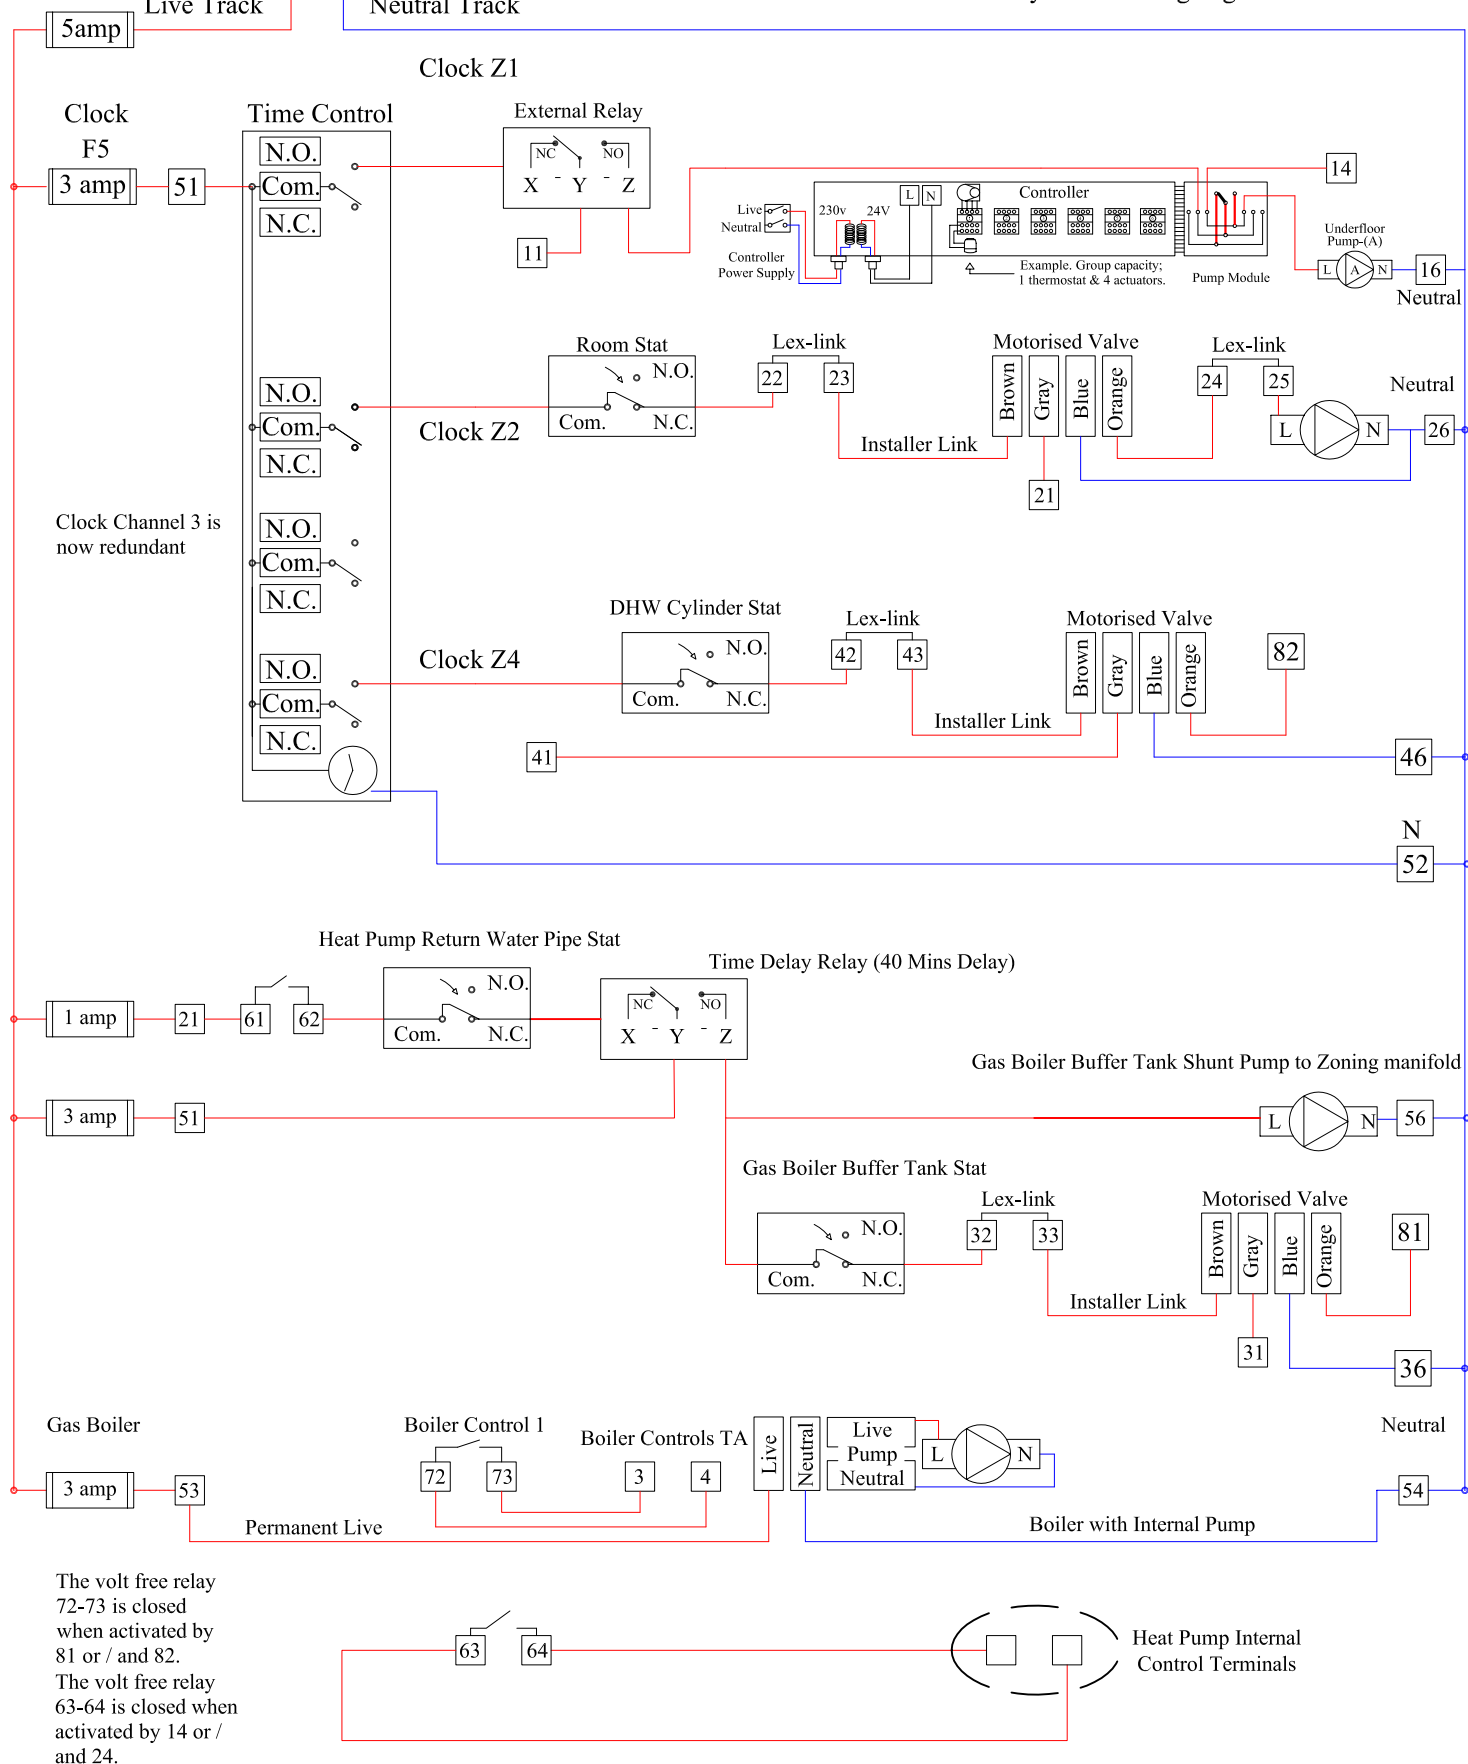

The volt free relay
72-73 is closed
when activated by
81 or / and 82.
The volt free relay
63-64 is closed when
activated by 14 or /
and 24.

SystemLink Ltd.
C2 South City Business Centre,
Tallaght, Dublin 24
Tel: 00-353-(0)1 4031200
Fax: 00-353-(0)1 4137777
e-mail: info@systemlink.ie

Example - Controls Wiring Schematic

Ref: RN Murphy

DETAILS

Scale: NTS

Rev: 010

Drawn: AK

Date: 06-11-09

To aid diagram clarity, EARTH connections are not shown but must be installed in accordance with manufacturers instructions